



Assessment of the Emer-Proof Advanced to AS 3740 for testing to AS/NZS 4858:2004 wet area membranes

Report number 8371 [This is a private relabel report from CSIRO test report 8370]

CSIRO agreement No.: 2020123192

Date of issue 31st August 2021

Client

Parchem Construction Supplies Pty Ltd

7 Lucca Road,

Wyong

NSW 2259

Australia

TERM OF VALIDITY

This CSIRO Wet Area Membranes report will lapse three years after the initial date of issue and assessment unless revalidation has been requested and granted.

The Report number 8371 valid until 31st August 2024

Commercial-in-confidence

Prepared on behalf of CSIRO by

Name Khanh Ho
Position Capability Lead – Slips and Membranes
Date 31th August 2021

Signature:



CSIRO Services
Infrastructure Technologies
Materials Performance
Gate 5, 2 Normanby Road
CLAYTON, VIC
AUSTRALIA 3168
Ph.: +61 (0)3 9545 2777
Web: <https://www.csiro.au/>
Fax: +61 (0)3 9544 1128

Use of Reports

Use of Reports – Testing

This report is subject to binding obligations under which it was prepared. In particular, the Report must not be used:

- As a means of endorsement; or,
- In a company prospectus or notification to a Stock Exchange document for capital raising, without the prior written consent of CSIRO.

The Report may be published verbatim and in full, provided that a statement is included on the publication that it is a copy of the Report issued by CSIRO.

Excerpts of the Report may not be published.

Use of Reports – Consultancy

This report is subject to binding obligations under which it was prepared. In particular, the Report may only be used for the following purposes:

- The information in the Report may be used by the party that commissioned the Report for its internal business operations (but not licensing to third parties);
- The report may be copied for distribution within the organisation that commissioned the Report;
- Copies of the Report (or extracts of the Report) may be distributed to contractors and agents of the organisation that commissioned the Report who have a need for the Report for its internal business operations. Any extracts of the Report distributed for this purpose must clearly note that the extract is part of a larger Report held by the organisation that commissioned the Report and which has been prepared by CSIRO.

The name, trade mark or logo of the CSIRO must not be used without the prior written consent of CSIRO.

The Report must not be used as a means of endorsement without the prior written consent of CSIRO.

Copyright and disclaimer

© 2021 CSIRO To the extent permitted by law, all rights are reserved and no part of this publication covered by copyright may be reproduced or copied in any form or by any means except with the written permission of CSIRO.

Important disclaimer

CSIRO advises that the information contained in this publication comprises observations based on test results. The reader is advised and needs to be aware that such information may be incomplete or unable to be used in any specific situation. No reliance or actions must therefore be made on that information without seeking prior expert professional, scientific and technical advice. To the extent permitted by law, CSIRO (including its employees and consultants) excludes all liability to any person for any consequences, including but not limited to all losses, damages, costs, expenses and any other compensation, arising directly or indirectly from using this publication (in part or in whole) and any information or material contained in it.

Limitation

The results reported herein relate only to the item(s) tested.

Contents

<i>Contents</i>	4
<i>Tables</i>	5
1 Summary.....	6
Test Standard:	6
Test results:.....	6
2 Introduction.....	7
3 Test specimen description.....	8
4 Test Methodology.....	9
4.1 <i>ASTM E96/E96M – 16 Water Vapour Transmission of materials</i>	9
4.2 <i>AS 3558.1-1999 Determination of water absorption characteristics</i>	9
4.3 <i>AS/NZS 4858-2004 Appendix B Resistance to cyclic movement</i>	9
4.4 <i>AS/NZS 4858-2004 Appendix A Durability of membrane</i>	10
5 Results	11
5.1 <i>ATSM E96/E96M - 16 Water Vapour Transmission of materials</i>	11
5.2 <i>AS 3558.1-1999 Determination of water absorption characteristics</i>	12
5.3 <i>AS/NZS 4858-2004 Appendix B Resistance to cyclic movement</i>	13
5.4 <i>AS/NZS 4858-2004 Appendix A Durability of membrane</i>	14
6 Comments	16

Figure 1 Top face of Emer-Proof Advanced.....	8
Figure 2 Underside of Emer-Proof Advanced.....	8
Figure 3 Test apparatus and weighing of Emer-Proof Advanced.....	12
Figure 4 Images of test sample performing durability load / elongation test	15

Tables

Table 1 Summary of test requirements and test specimen results for AS/NZS 4858:2004.....	6
Table 2 Details of submitted test specimen	7
Table 3 Details of the schedule for testing of the submitted specimen	7
Table 4 Water Vapour Transmission test results	11
Table 5 Water absorption tests results	12
Table 6 Test sample holding during cyclic movement and test results.....	13
Table 7 Durability test results.....	14

1 Summary

Test Standard: Testing was conducted on a waterproofing membrane used for internal wall and floor tiled areas, to assess its performance for: water vapour transmission; water absorption; acceptance of cycle movement; and, durability. The waterproofing properties required by AS 3740 were tested in accordance to the Australian Standard AS/NZS 4858-2004.

All methods were carried out according to Table A1 durability of membranes against the performance criteria of Table 8.1.

Test results: The waterproofing membrane presented for testing complied with the performance criteria set in AS/NZS 4858-2004 'Wet area membranes', confirmed against AS 3740. The following table shows the Emer-Proof Advanced performance as assessed from testing.

Table 1 Summary of test requirements and test specimen results for AS/NZS 4858:2004

TEST	METHOD	REQUIREMENTS	RESULT	STATUS
(a) Moisture Transmission Rate	ASTM E 96 Desiccant method for Determining Water Vapour Transmission (WVT)	Water Vapour transmission shall be $<8 \text{ g} / \text{m}^3 / 24\text{hrs}$. If $> 8 \text{ g} / \text{m}^3 / 24\text{hrs}$, additional testing will be required to establish suitability for use over particleboard.	WVT 3.83 $\text{g}/\text{m}^2/24\text{hrs}$ Permeance 26.31 $\text{ng}/\text{Pa}\cdot\text{s}\cdot\text{m}^2$	Complied
(b) Water Absorption	AS 3558.1 Average percentage increase in mass	Maximum record result of percentage mass $w_m\% = (w_m^2 - w_m^1) / w_m^1 \times 100$.	Max. mass 2.14 %	Complied
(c) Acceptance of movement	AS/NZS 4858 Appendix B for assessment of cyclic movement of membrane	Pass or fail criteria by observing any cracking, rupture holing or extending through the thickness for more than 1 mm in from the edge of the specimen.	Class III	Complied
(d) Durability 1. Control 2. Water immersion 3. Bleach immersion 4. Detergent immersion 5. Heat ageing at 50°C	AS/NZS 4858 & Appendix A for assessment of membranes durability	Pass or fail criteria; compared to control samples, elongation at break shall be not less than 50 % for the bond breakers given in Table 6.1.	Class III	Complied

Note: The above is only a summary of the overall results, and must be read in conjunction with the relevant sections of this report.

2 Introduction

CSIRO Services was engaged by Parchem Construction Supplies Pty Ltd to assess a waterproofing membrane for compliance against AS 3740-2010 ‘Waterproofing of domestic wet areas’, Section 2, Clause 2.4.1 (d) ‘Membranes meeting the requirements of AS/NZS 4858’, determined by testing to AS/NZS 4858:2004, ‘Wet area membranes’ (this Standard sets out the methods for establishing the physical properties for wet area membranes). The details for this assessment are listed in Table 2 below.

Table 2 Details of submitted test specimen

CSIRO Agreement No.:	2020123192
TEST SPONSOR:	Parchem Construction Supplies Pty Ltd
PRODUCT DESCRIPTION:	Emer-Proof Advanced

Note: CSIRO accepts no responsibility for the selection of specimens. The results in this report apply to the specimens tested and may not be applicable to other specimens of the same product.

This report details the performance, testing conditions and outcomes of the specimen assessed for wet area membranes. Table 3 details the sponsor’s specified schedule of tests for the product.

Table 3 Details of the schedule for testing of the submitted specimen

CSIRO Agreement No.:	2020123192
TEST SCHEDULE:	<p>AS/NZS 4858:2004 wet area membranes, Clause 8 Table 8.1:</p> <ul style="list-style-type: none"> a) Moisture vapour transmission rate - ASTM Designation E96/E96M – 16, ‘Standard Test Methods for Water Vapour Transmission’; b) Water absorption AS 3558.1-1999 ‘Method of testing plastics and composite materials sanitary plumbing fixtures, Method 1 Determination of water absorption’; c) Acceptance of cyclic movement; Appendix B ‘Assessment of resistance of waterproofing membranes to cyclic movement’; and, d) Durability - Appendix A ‘Assessment of durability of waterproofing membranes: <ul style="list-style-type: none"> Table A1 (a) Controls Table A1 (b) Water immersion Table A1 (c) Bleach immersion Table A1 (d).Detergent immersion Table A1 (e) Heat aging 50°C

3 Test specimen description

The Emer-Proof Advanced supplied by Parchem Construction Supplies Pty Ltd is a non-flammable polyurethane, single component waterproofing membrane. The nominal size of the membrane was 200 mm wide, 430 mm length and 1.40 mm thick.

The supplied specimen for assessment is shown below in Figures 1 and 2.

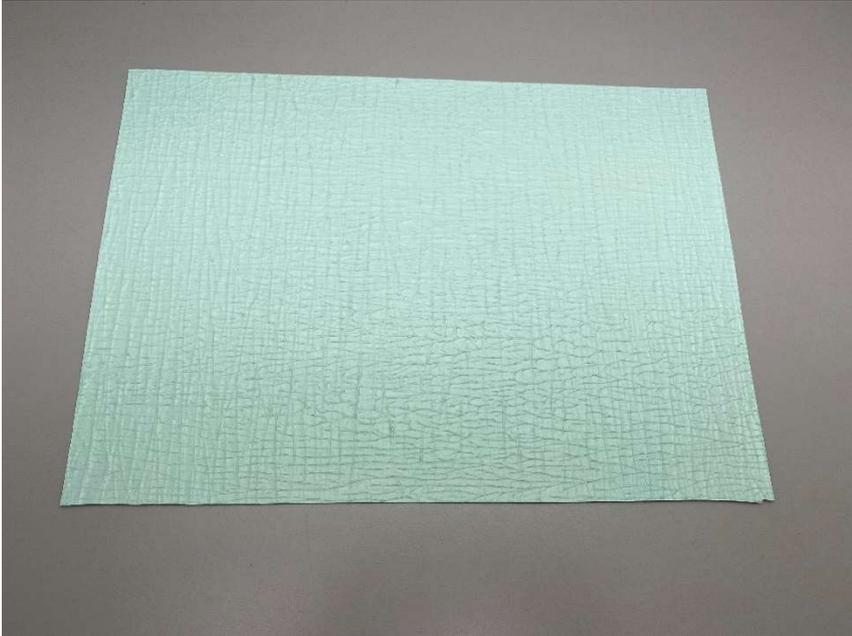


Figure 1 Top face of Emer-Proof Advanced

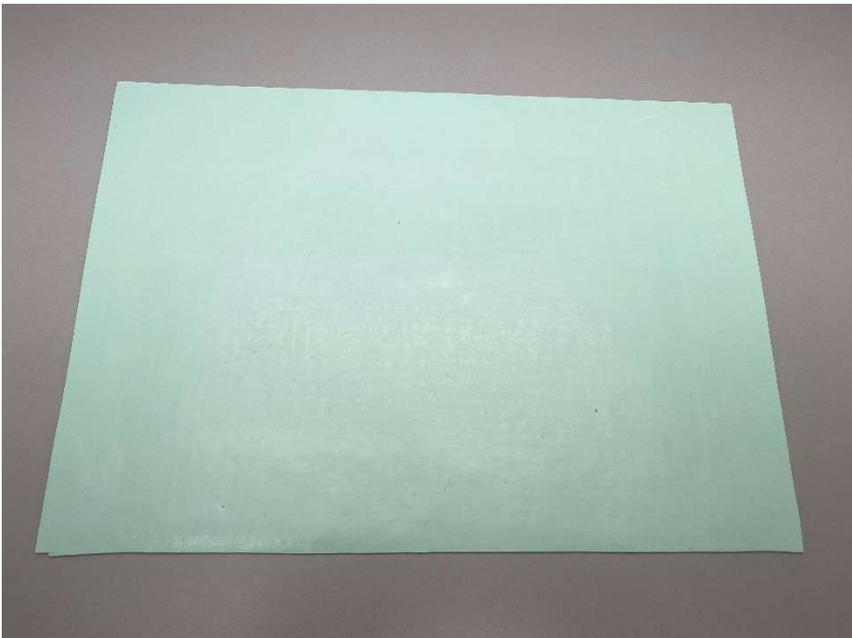


Figure 2 Underside of Emer-Proof Advanced

4 Test Methodology

4.1 ASTM E96/E96M – 16 Water Vapour Transmission of materials

This Standard outlines the method for determining water vapour transmission (WVT) through the membrane using the desiccant and dummy sample method.

Four test samples were prepared by mechanical sealed using two neoprenes and a teflon gasket placed onto the open side of the test cups. The test cups contain dried desiccant with the trafficable side facing up were placed in a climate-controlled environment with periodic weighing so that the rate of water vapour movement through the membrane to the desiccant can be determined.

The exposed area (test dish face) for each of the cups was 0.002827 m². The test cups (all except the dummy sample, no desiccant) had a 6 mm gap between the desiccant and the underside of the membrane.

All test assemblies were kept in a Steridium environmental where chamber temperature humidity are maintained at a temperature of 23 ±2°C and 60 ±5% relative humidity, for the 46 days duration.

Measurements taken each afternoon (excluding weekends) over this period to determine the weight change and permeance of the membrane.

4.2 AS 3558.1-1999 Determination of water absorption characteristics

This Standard outlines the method for determining the percentage of mass change of the membrane measured after a period of immersion in water, followed by a period of being oven dried.

Three circular test samples of 80 mm diameter (5027 mm²) were cut from Emer-Proof Advanced, before been placed in an oven set at 50 ±5°C for a duration of 24 ±0.5 hrs conditioning. Samples were removed from oven (cooled) then weighed and recorded (m¹) before insertion in a test jig. The test jig was used to expose the trafficable surface face of the samples to water to a depth of 50 mm above the surface for a duration of 24 ±0.25 hrs. After the completion of this exposure period the samples were wiped dry and then weighed and recorded (m²) again, determining the percentage increase in weight measured.

4.3 AS/NZS 4858-2004 Appendix B Resistance to cyclic movement

This Standard outlines the method for determining resistance of membrane to cyclic movement set at 4mm extension.

A rectangular test sample of 65 mm x 25 mm x 1.40 mm was cut from the Emer-Proof Advanced, then held in the test grips (70(w) x 45(l) x 20(t) mm), exposing a 25 x 2 mm central portion of the sample.

An Applied Test Systems Series 904 Vertical Sealant Tester was used for testing. The vertical sealant testing machine used software for cyclic movement control. The vertical testing machine was set to elongate the clamped test sample for the cycling is 4mm extension. Once the test piece reached full extension, it then returned to its original position, which completed one cycle of movement. The elongation and return was then repeated to complete a 50 cycle movement test, each cycle conducted over a nominal 2 hour period.

The test sample was inspected for signs of breakage or cracks and measured for any necking. A reduction in width of more than 1 mm inwards from the edge of the test sample constitutes a failure.

4.4 AS/NZS 4858-2004 Appendix A Durability of membrane

This Standard outlines the method for determining resistance of the membrane's durability after conditioning in various solutions over set periods, then assessed against an unconditioned material.

Testing of the Emer-Proof Advanced was in accordance with Appendix A Durability of membranes. As specified in A3 the membrane test samples were prepared in accordance with AS 1145.3-2001, Type 5, dumb-bell samples 6mm width with a 25mm gauge length. Test samples were exposed and conditioned to those requirements specified in Table A1 of AS/NZS 4858:2004.

In accordance with A2 Testing, a universal testing machine, fitted with a calibrated 5kN load cell, was used to record the elongation at break and tensile strength. The elongation at break of the immersed test samples were compared to the control test samples.

5 Results

Results reproduced from base variant product, reference report 8370.

5.1 ATSM E96/E96M - 16 Water Vapour Transmission of materials

The periodic measurements of the membrane test samples were recorded as shown in Table 4, below.

Date of test: 22 February 2021 – 9 April 2021

Table 4 Water Vapour Transmission test results

Product	Samples	Weight change	Water Vapour Transmission	Permeance
		G/t = g / s	(G/t)/A = g / m ² 24hr	WVT/(S9R1-R2) = ng/Pa.s.m ²
Emer-Proof Advanced	8370/53	1.2 x 10 ⁻⁷	3.71	25.50
	8370/54	1.3 x 10 ⁻⁷	3.93	26.98
	8370/55	1.3 x 10 ⁻⁷	3.85	26.45
	Average	2.3 x 10 ⁻⁷	3.83	26.31

The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1, specifies a water vapour transmission rate of less than 8 g/m² 24 hr, or 0.33 g/m² hr.

5.2 AS 3558.1-1999 Determination of water absorption characteristics

Results reproduced from base variant product, reference report 8370.

The measured dimensions of the test samples placed in the test rig stand are shown in Table 5, below.

Date of test: 25th February 2021

Table 5 Water absorption tests results

Product	Thickness Average	Samples	Sample weight after conditioning	Sample weight after exposure	Water absorption percentage
	mm		m ¹ = grams	m ² = grams	M % = (m ² – m ¹) / m ¹ x100
Emer-Proof Advanced	1.50	8370/49	9.8510	10.0594	2.12 %
	1.56	8370/50	10.0666	10.2810	2.13 %
	1.53	8370/51	10.0677	10.2827	2.14 %
					Average = 2.13 %

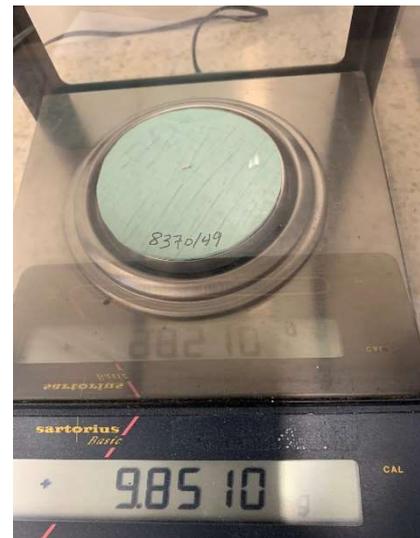


Figure 3 Test apparatus and weighing of Emer-Proof Advanced

The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1 (b), does not specify a limit. The maximum water absorption measured on the waterproofing membrane samples was 2.14%.


5.3 AS/NZS 4858-2004 Appendix B Resistance to cyclic movement

Results reproduced from base variant product, reference report 8370.

The test result for cyclic movement of the waterproofing membrane test sample is shown in Table 6 below. The test sample completed 50 cycles for the nominal 2 hour period.

Date of test: 11 February 2021 – 15 February 2021

Table 6 Test sample holding during cyclic movement and test results

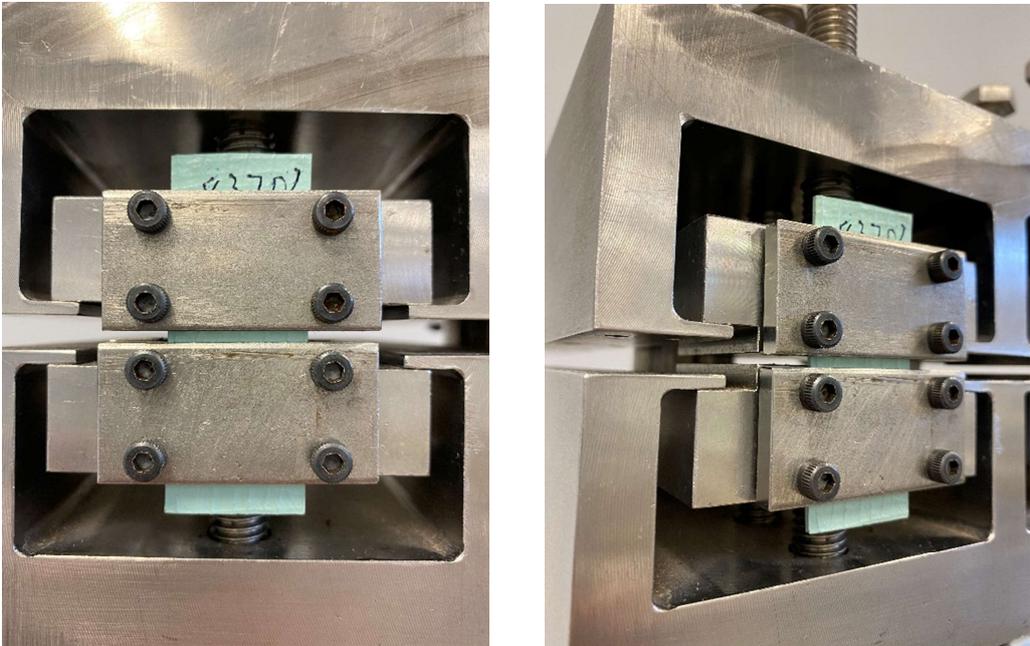Specimen:	Emer-Proof Advanced
Test sample and elongation at break:	Test sample 65 (l) mm x 25 (w) mm x 1.40 (t) mm section; Maximum extension movement used for the cycling is 4mm extension – Class III.
Clamped test sample of cyclic test:	
Observation and measurement:	<p><u>Observations:</u></p> <p>At test completion the specimen showed no signs of rupture holing or cracking.</p>

The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1 (c) and section B4, pass or fail criteria by observing any rupture holing the specimen or extending through the thickness for more than 1 mm in from the edge of the specimen.

5.4 AS/NZS 4858-2004 Appendix A Durability of membrane

Results reproduced from base variant product, reference report 8370.

The tensile strength and elongation at break were recorded for the control and immersed test samples. Criteria for pass or failure of the immersed test samples were then compared to the control samples. AS/NZS 4858:2004 Table 6.1 joint movement bond breaker was also referenced in Table 7, below.

Date of test: 08 February 2021, 18 February 2021, 11 March 2021, 2 April 2021, 4 April 2021 and 8 April 2021.

Table 7 Durability test results

Emer-Proof Advanced			Tensile Strength and Elongation		
Control samples	Break Force (N)	Thickness (mm)	Tensile strength (F/A) (MPa)	Elongation at break (mm) & (%)	Passed/Failed
8370/01	37.32	1.40	4.44	80.51 & 322	-
8370/02	31.92	1.40	3.80	86.24 & 345	-
8370/03	36.89	1.39	4.42	85.34 & 341	-
8370/04	34.23	1.43	3.99	85.09 & 340	-
8370/05	32.24	1.43	3.76	84.89 & 340	-
Average	34.52	1.41	4.08	84.41 & 338	-
Water Immersion	Average (N)		Average (MPa)	Average (mm) & (%)	-
7 day period	33.87	1.46	3.88	61.26 & 245	Passed*
28 day period	20.30	1.42	2.38	92.39 & 370	Passed*
56 day period	21.91	1.42	2.58	88.54 & 354	Passed*
Bleach Immersion	Average (N)		Average (MPa)	Average (mm) & (%)	-
7 day period	24.54	1.38	2.96	100.85 & 403	Passed*
28 day period	24.56	1.44	2.84	96.66 & 387	Passed*
56 day period	23.94	1.37	2.91	97.60 & 390	Passed*
Detergent Immersion	Average (N)		Average (MPa)	Average (mm) & (%)	-
7 day period	34.64	1.35	4.29	84.83 & 339	Passed*
28 day period	37.62	1.37	4.58	89.70 & 359	Passed*
56 day period	22.55	1.38	2.74	105.92 & 424	Passed*
Heat Ageing @ 50°C	Average (N)		Average (MPa)	Average (mm) & (%)	-
7 day period	37.44	1.39	4.51	69.10 & 276	Passed*
Table A1: Pass / Fail and Criteria compared with control samples			*Passed – Elongation at break was above the 25% limit; and all immersed samples were above the 50% criteria for elongation at break Control samples. Class III of Table 6.1.		

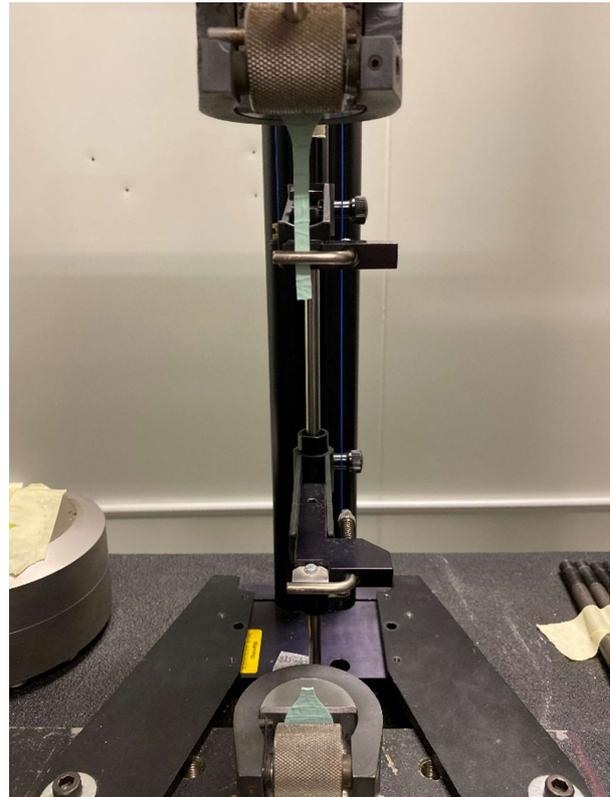
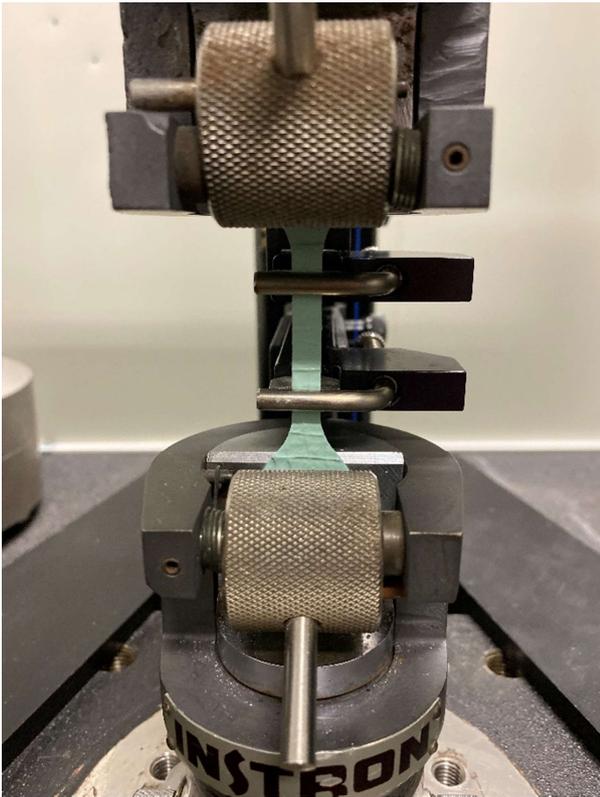


Figure 4 Images of test sample performing durability load / elongation test

The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1 (d), specifies a comparison of the immersed test samples to the unconditioned (control) test samples shall be greater than 50% elongation at break.

6 Comments

The Emer-Proof Advanced, as described herein, when subjected to the test methods of AS/NZS 4858:2004 '*Wet area membranes*', the properties of (a) moisture vapour transmission, (b) water absorption, (c) cyclic movement (Class III), and (d) durability (Class III), met the performance criteria to AS/NZS 4858:2004 Wet Area Membranes.

End of report